
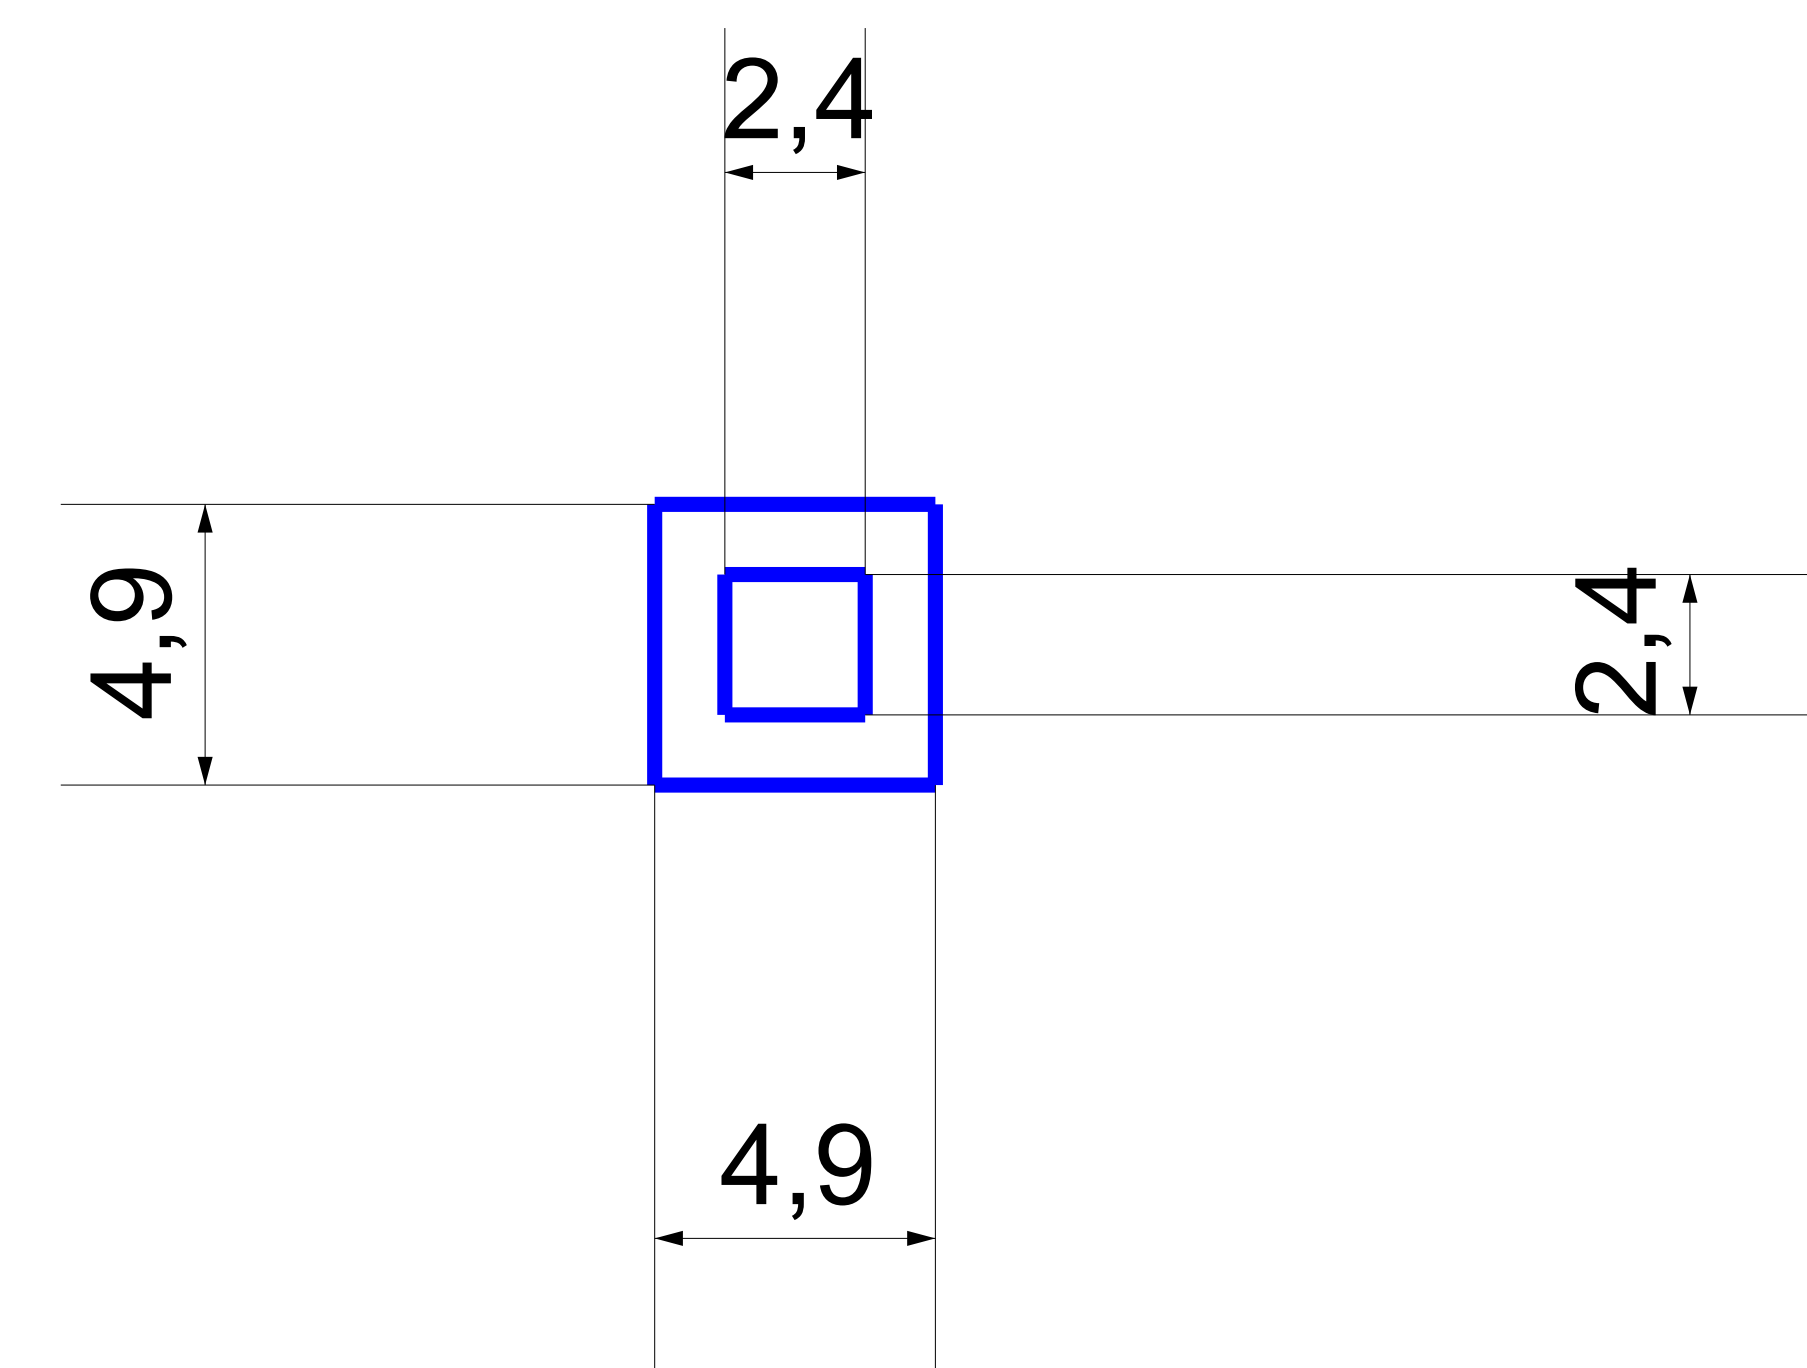


MINIMUM CLEARANCE



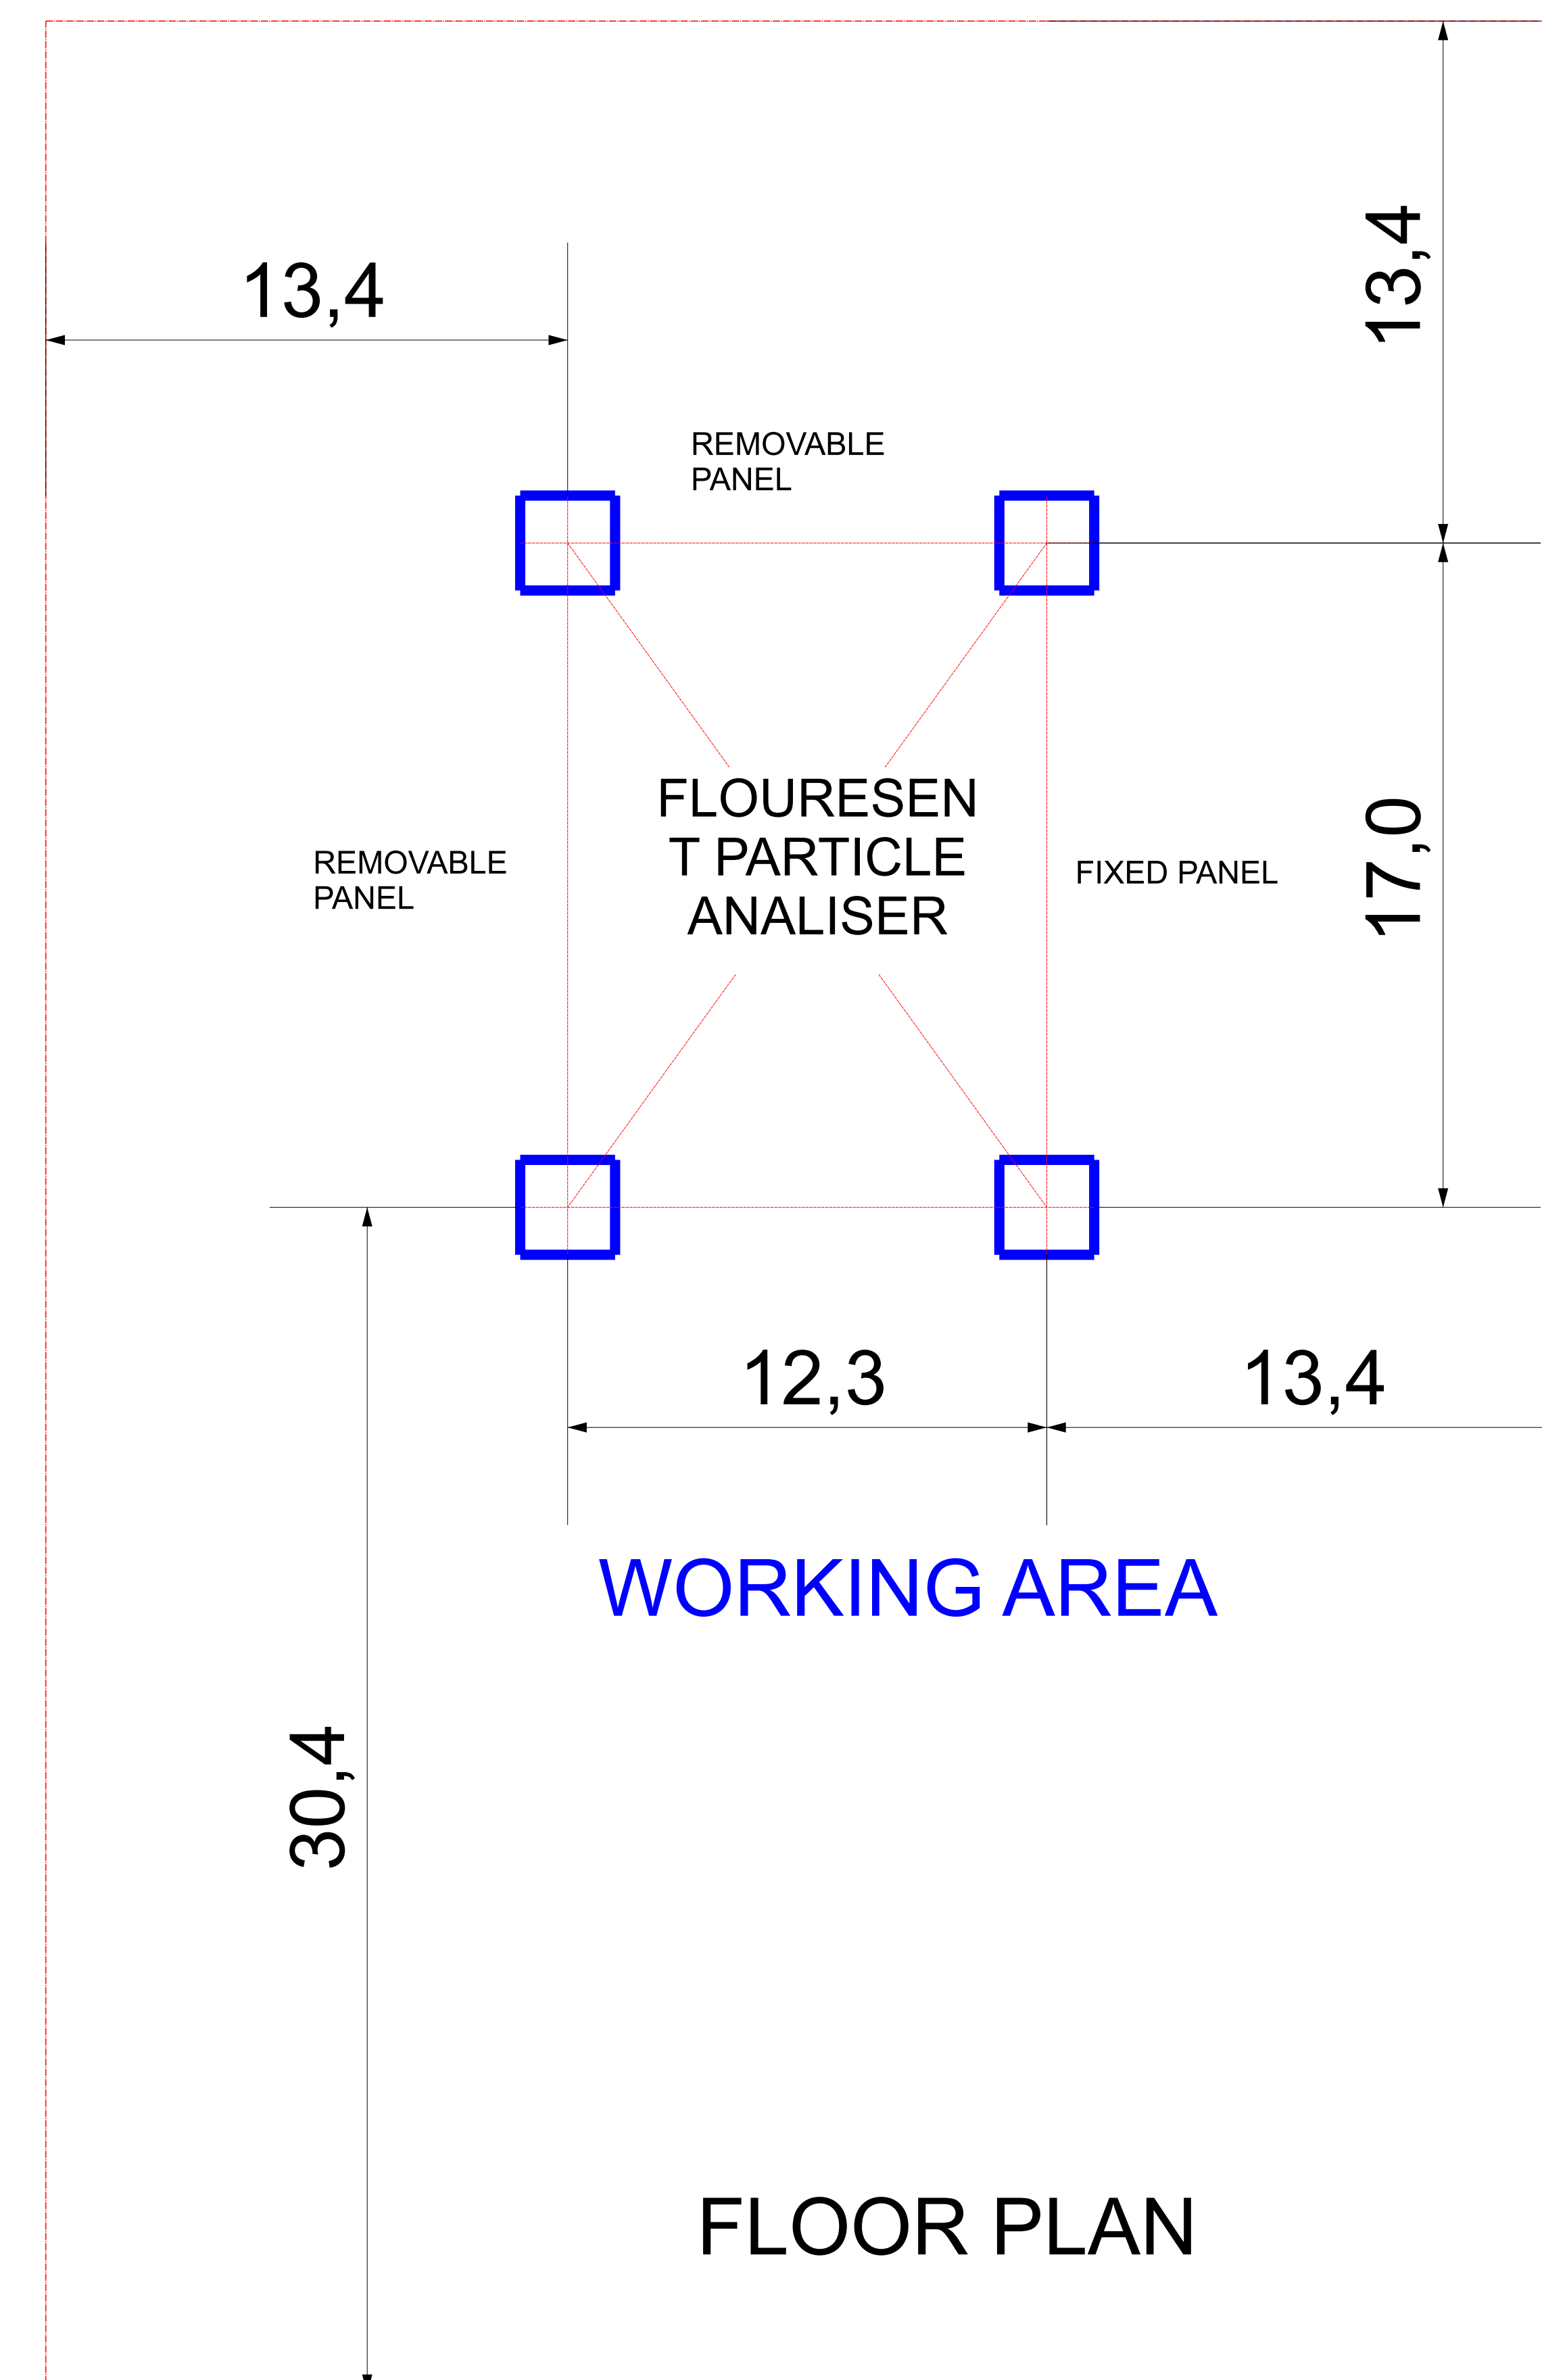


TYPICAL FOOT PRINT

WATER SUPPLY: MUST BE FILTERED THOUGH A 250 MICROM
FILTER. PREASURE NOT TO BE LESS THAN 400kPa AND NOT
EXCEED 1000kPa SEE NOTE A


ELECTRIC SUPPLY: 220V, 16A, 50/60Hz, SINGLE PHASE. SEE NOTE
B

WEIGHT: +/- 150KG

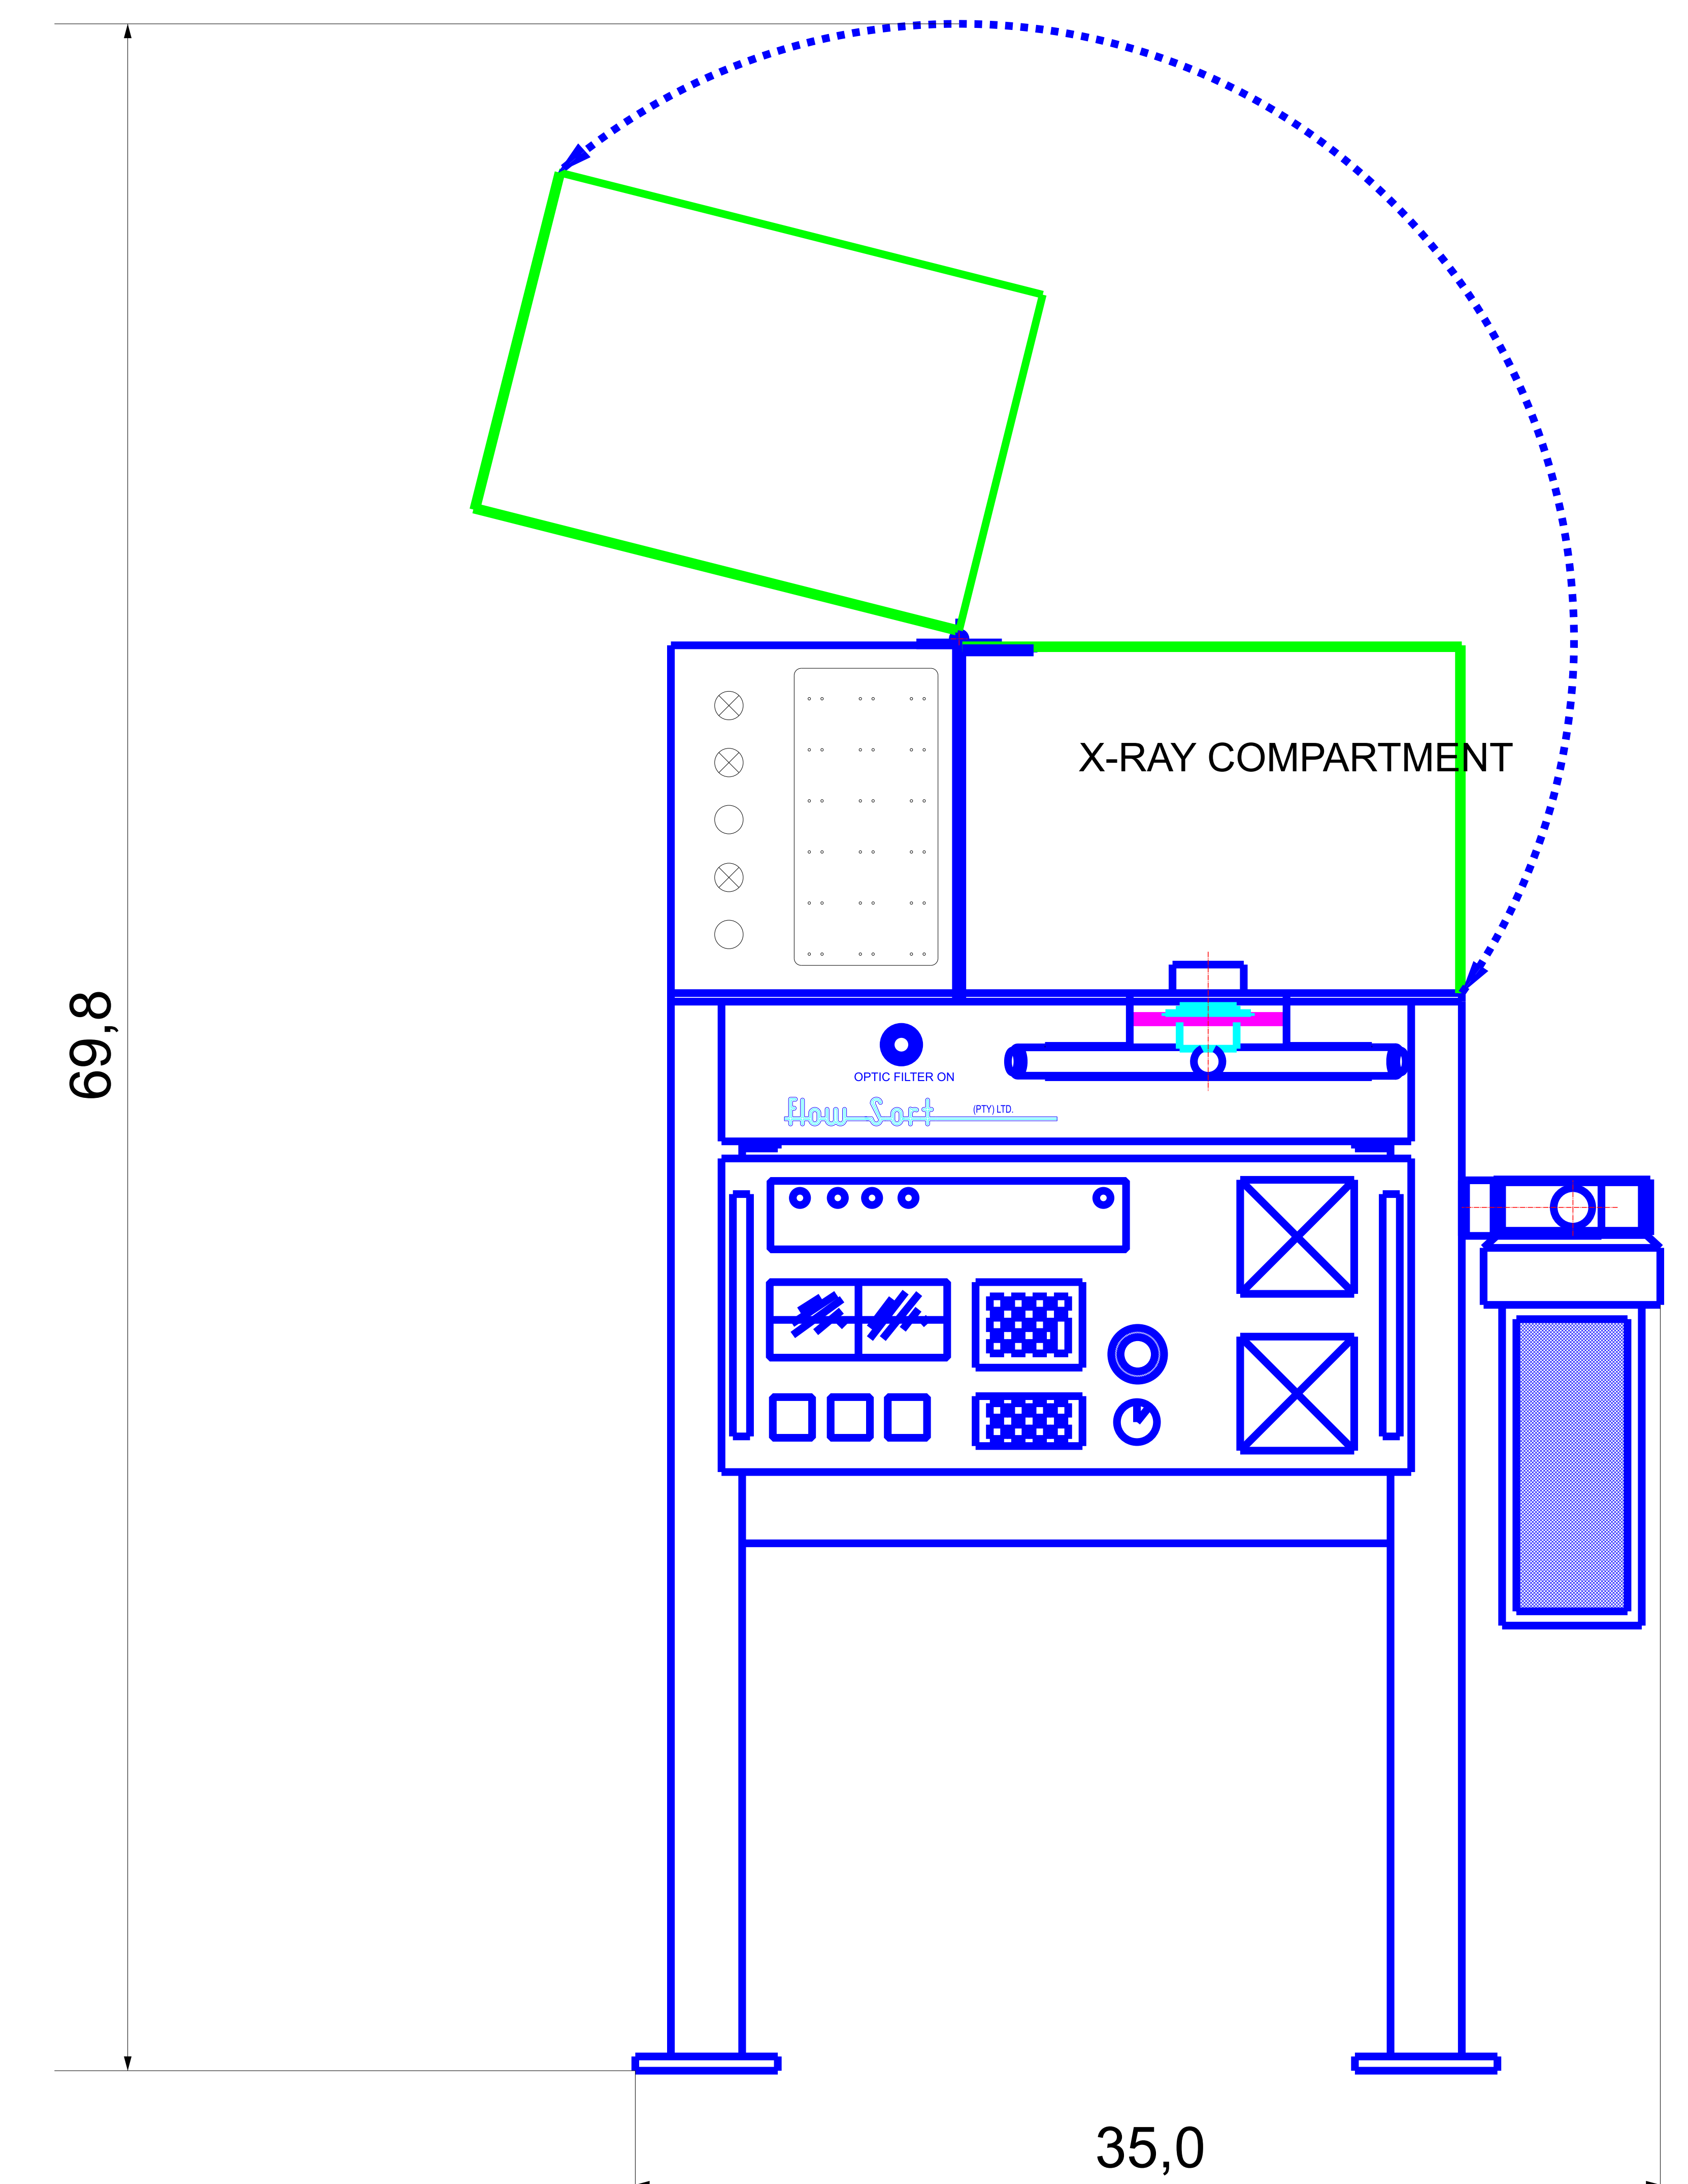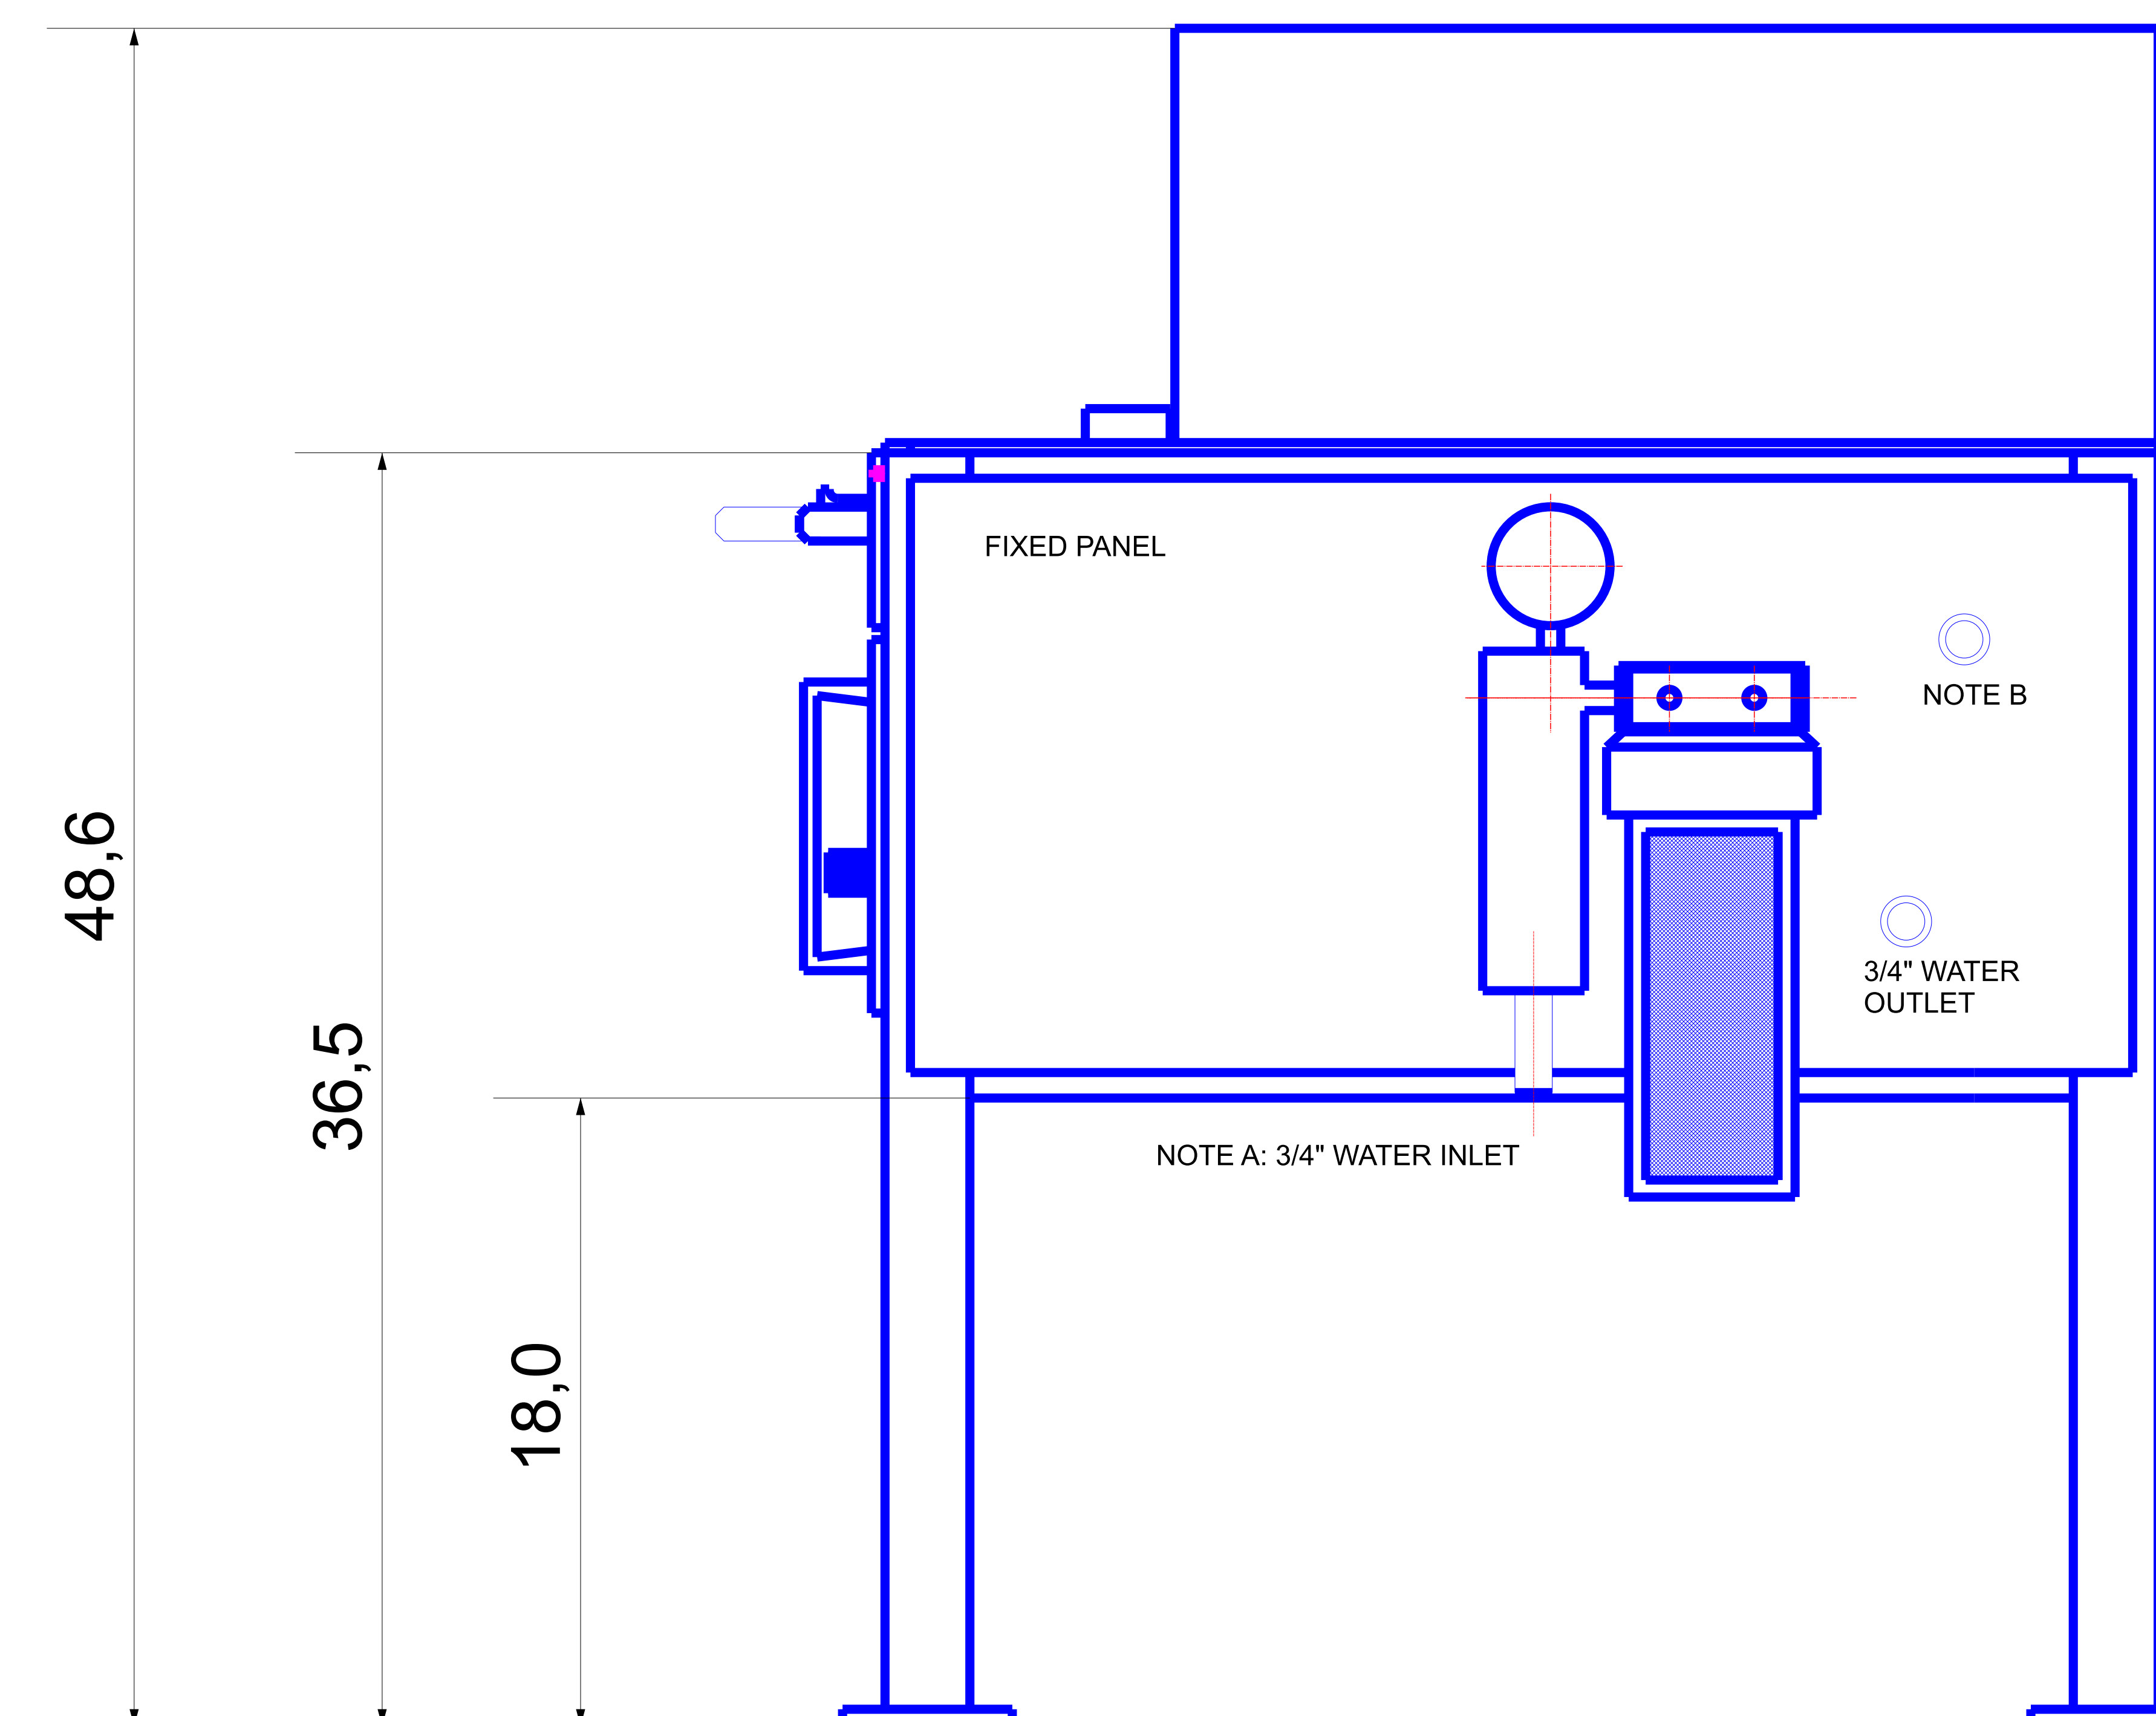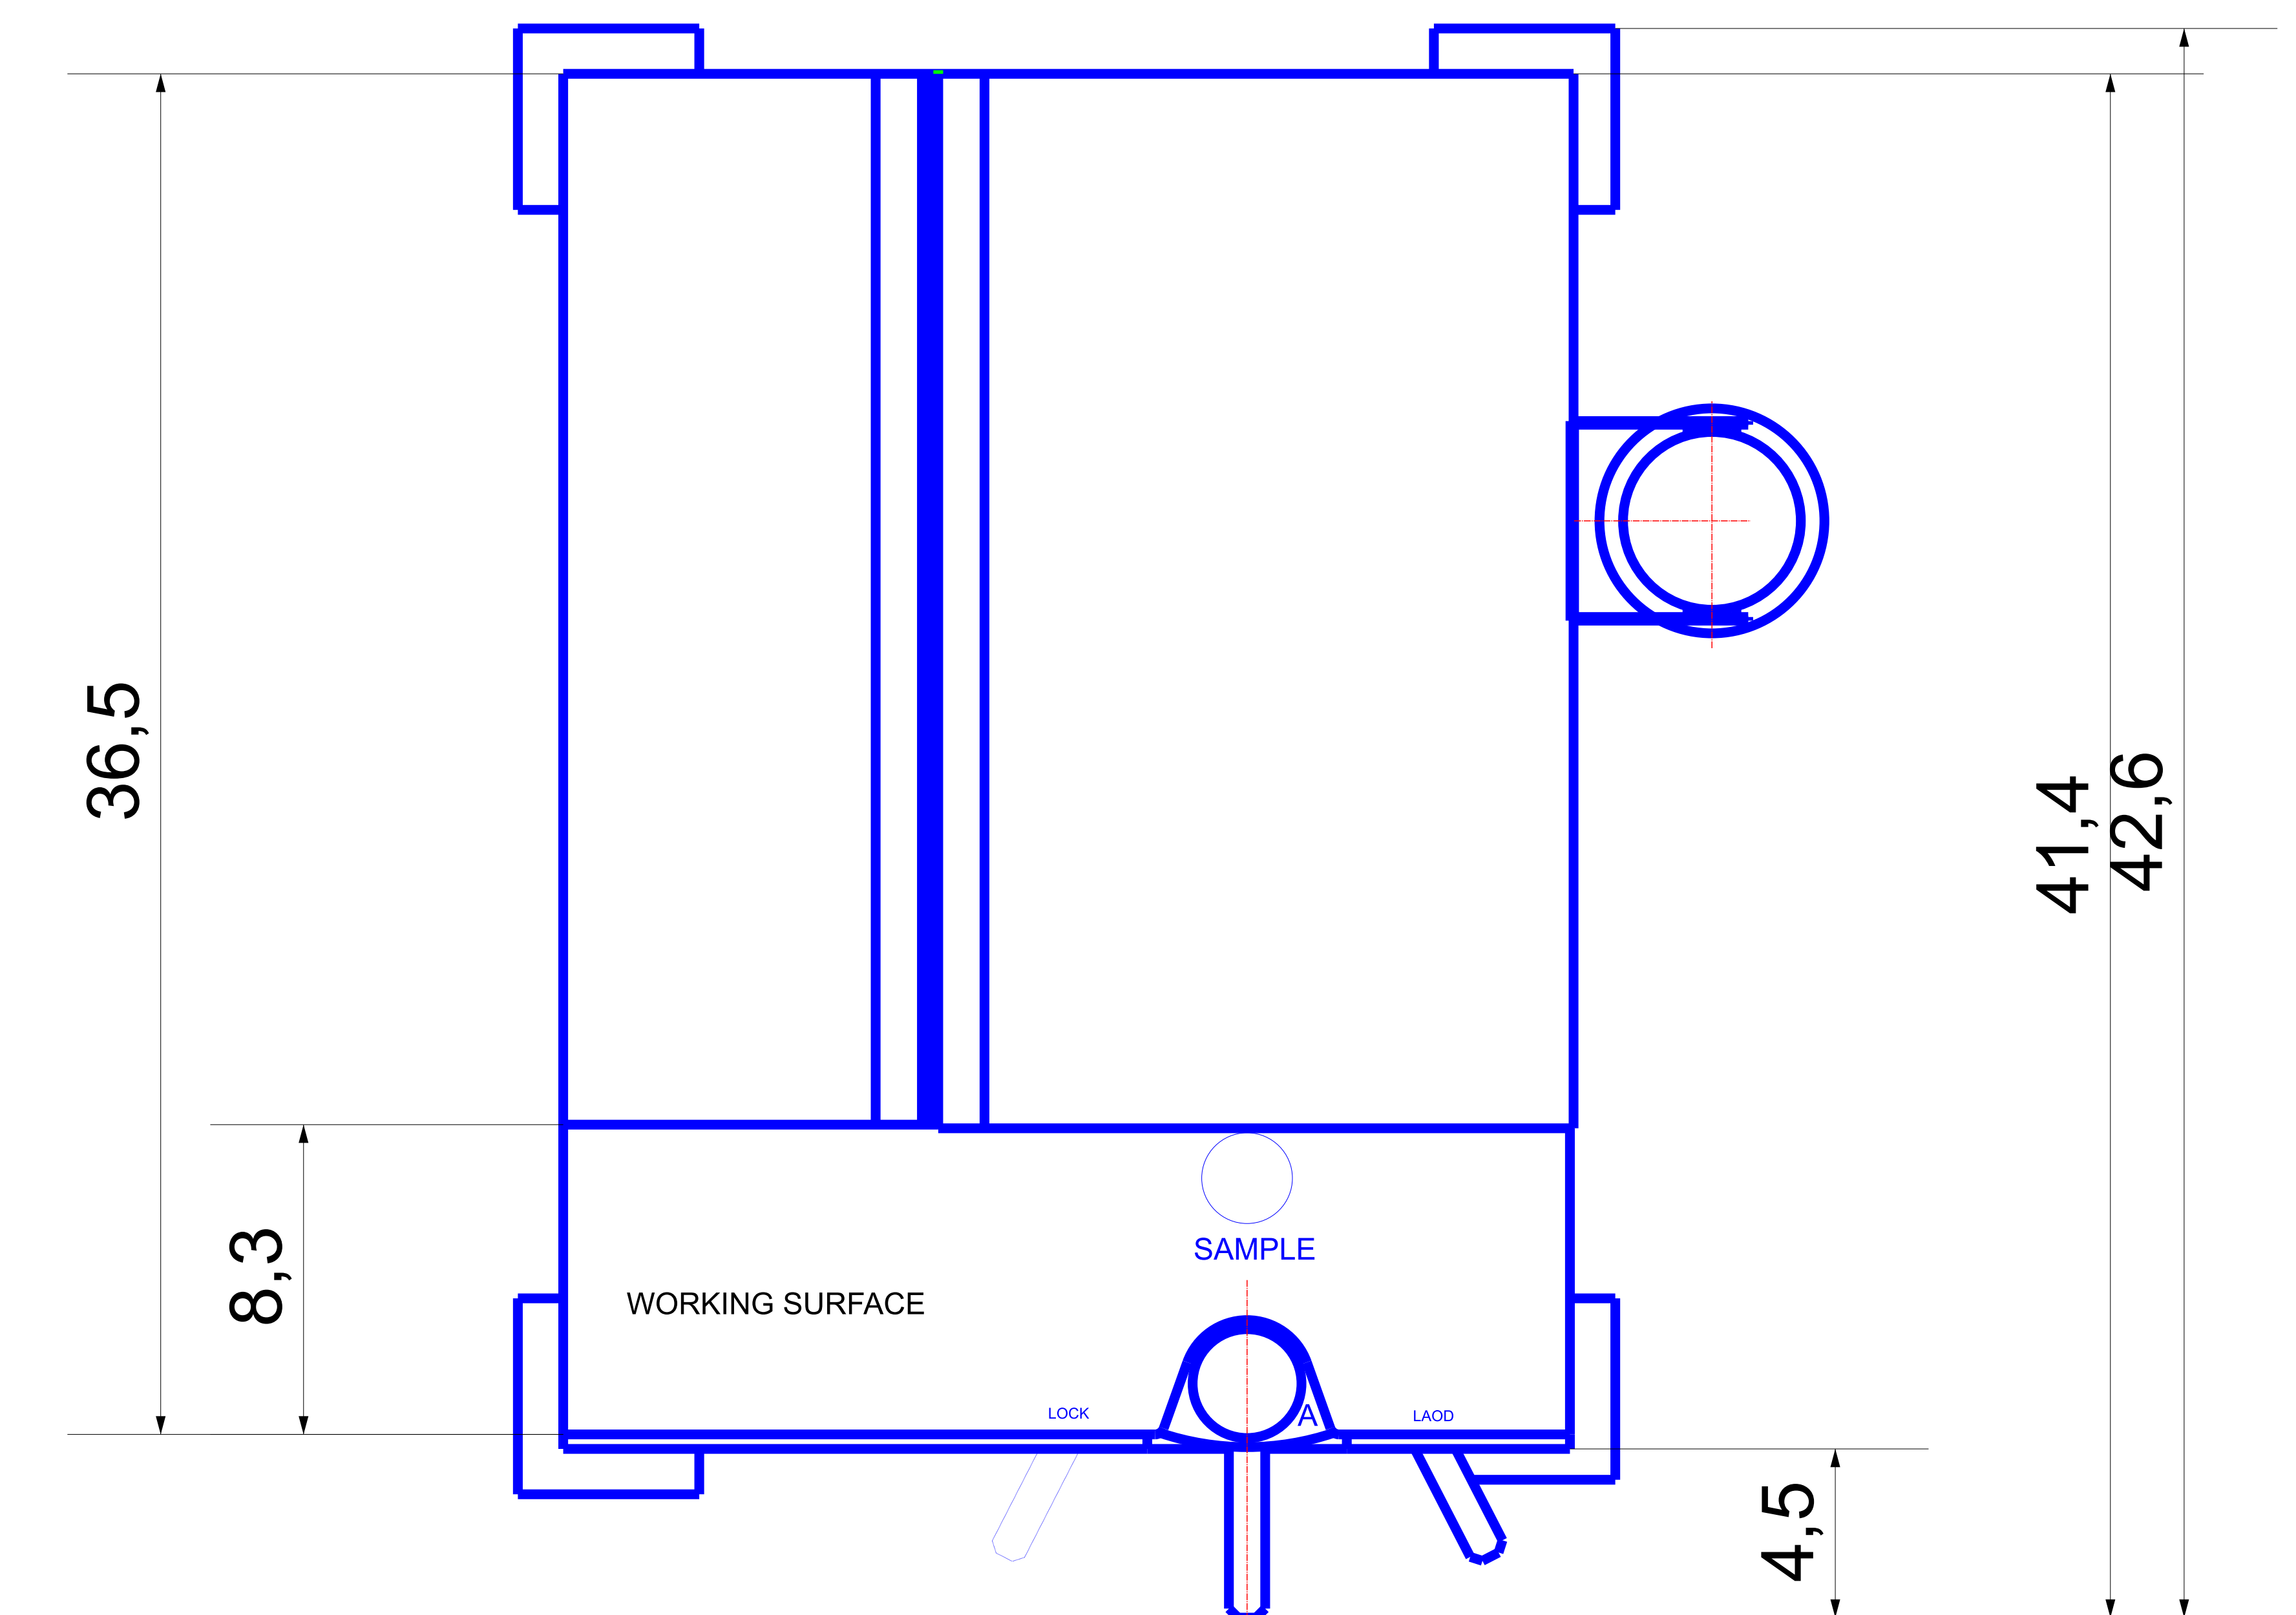

FPA_GA_01.DWG

This print is loaned subject to return upon demand, and upon the express condition that it is not to be reproduced or copied or information from it furnished to others or to be used in any way detrimental to the interests of FLOW SORTS (PTY) LTD.

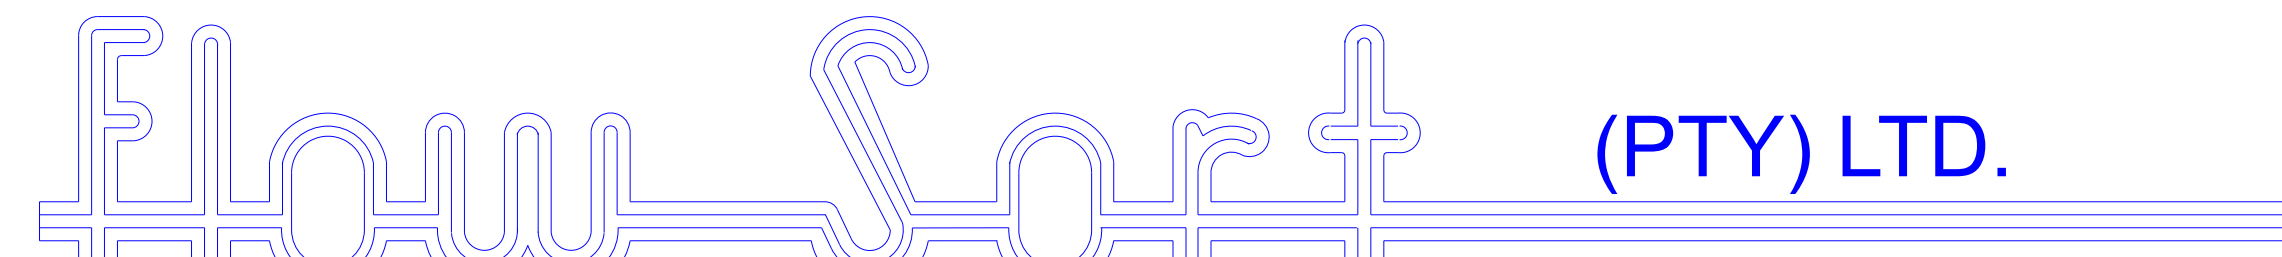							ITEM	QTY	DRG. NO.	DESCRIPTION		MATERIAL	REMARKS
							SCALE	NTS.		FLOURESENT PARTICLE ANALISER GENERAL ARRANGEMENT			
							DATE	2001/08/15					
							DRAWN	CMW					
							APPROVED						
							DRAWING No.						
REFERENCE DRAWINGS	DRG. No.	REVISIONS	MARK	FIELD	DATE	INIT.	FPA_GA_01.DWG						